





Utility Usage Information

December 30 2015



Aitkin High School

Utility Usage Summary

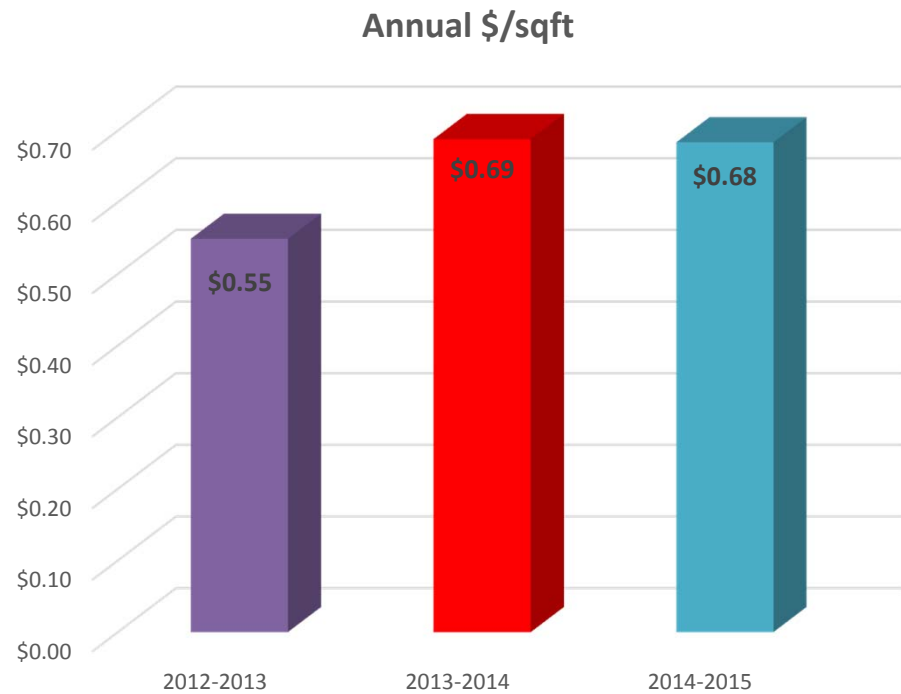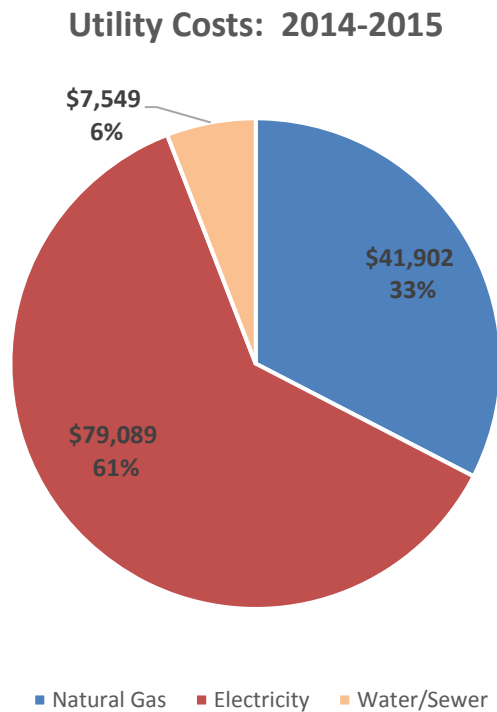

Aitkin High School

Utility Usage Summary

Aitkin High School

188,000 sqft


Year	NATURAL GAS				ELECTRICITY								Water/Sewer			TOTALS	
	Therms	kBtu/sqft	\$	\$/sqft	kWh	kWh \$	kBtu/sqft	kW	kW \$	Total \$	\$/sqft	Gallons	\$	\$/sqft	\$	\$/sqft	
2012-2013	59,125	31.4	\$30,487	\$0.16	672,768	\$45,628	12.2	2,268	\$20,412	\$66,040	\$0.35	899,100	\$6,683	\$0.04	\$103,211	\$0.55	
2013-2014	67,099	35.7	\$45,160	\$0.24	806,400	\$55,194	14.6	2,441	\$21,965	\$77,159	\$0.41	959,800	\$7,055	\$0.04	\$129,373	\$0.69	
2014-2015	60,978	32.4	\$41,902	\$0.22	813,312	\$56,997	14.8	2,412	\$22,092	\$79,089	\$0.42	1,033,300	\$7,549	\$0.04	\$128,541	\$0.68	
Avg.	62,401	33.2	\$39,183	\$0.21	764,160	\$52,607	13.9	2,374	\$21,490	\$74,096	\$0.39	964,067	\$7,096	\$0.04	\$120,375	\$0.64	




Aitkin High School

Electrical Usage Summary

Electricity Usage (kWh)

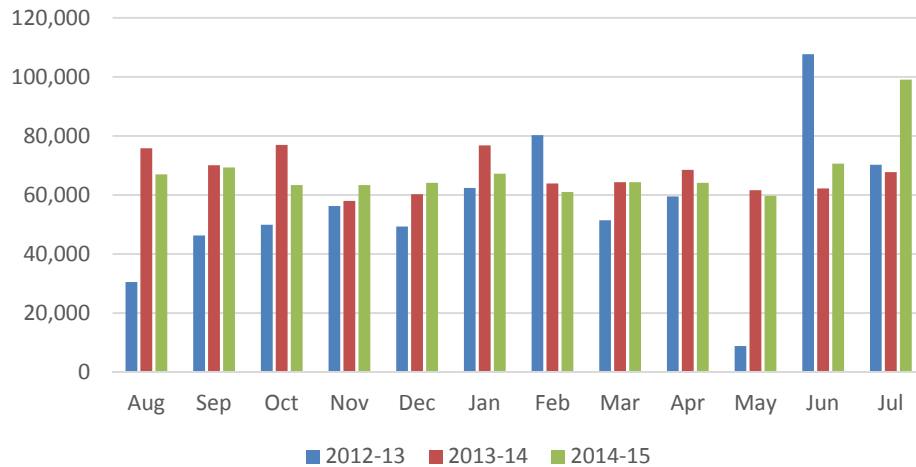


Electricity Demand (kW)

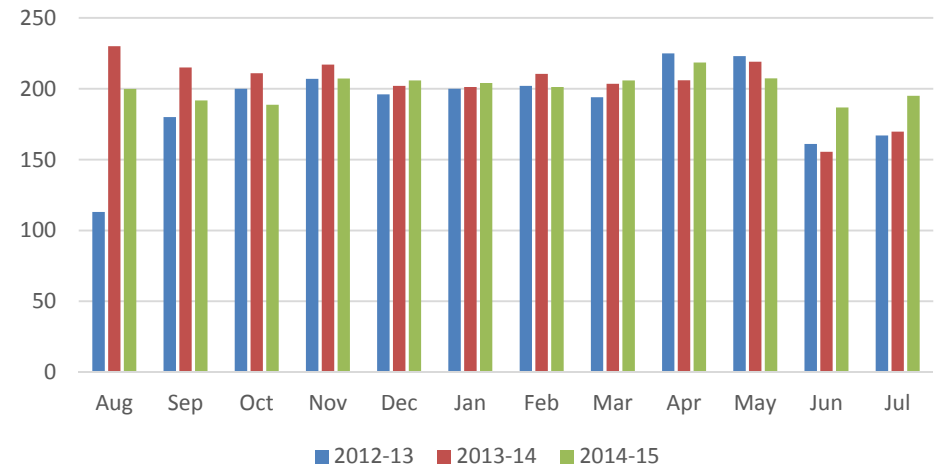


Aitkin High School

Natural Gas Usage Summary

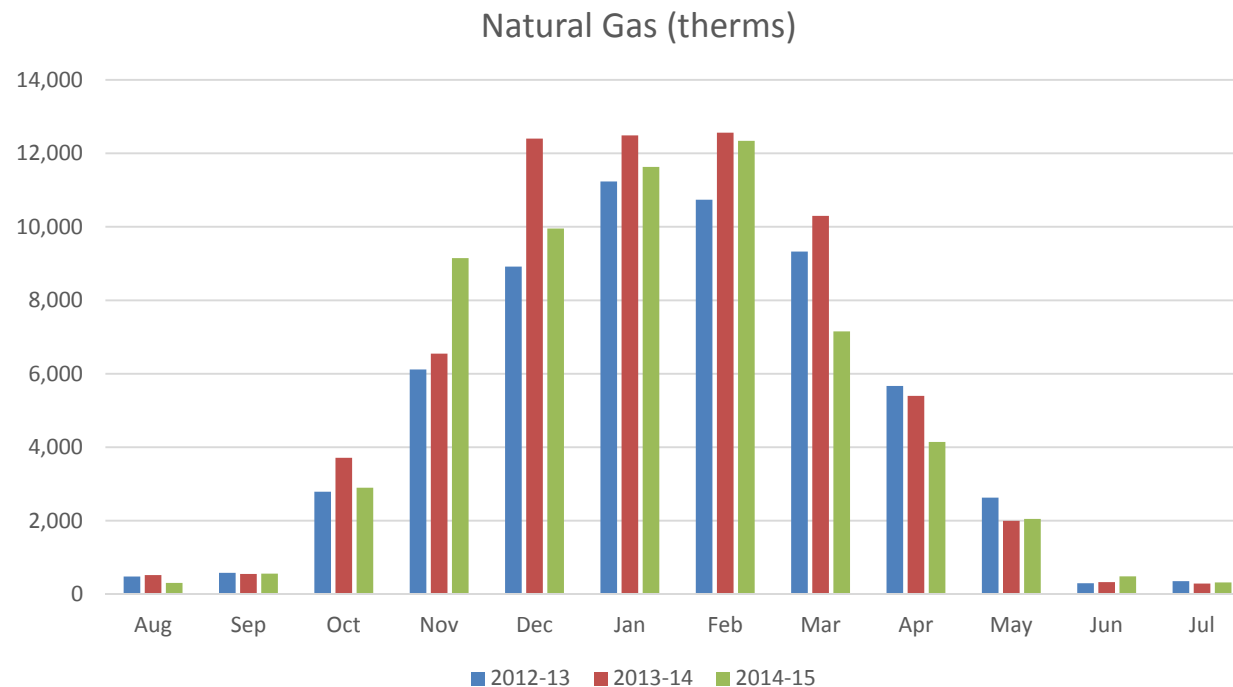



Aitkin High School

Water Usage Summary

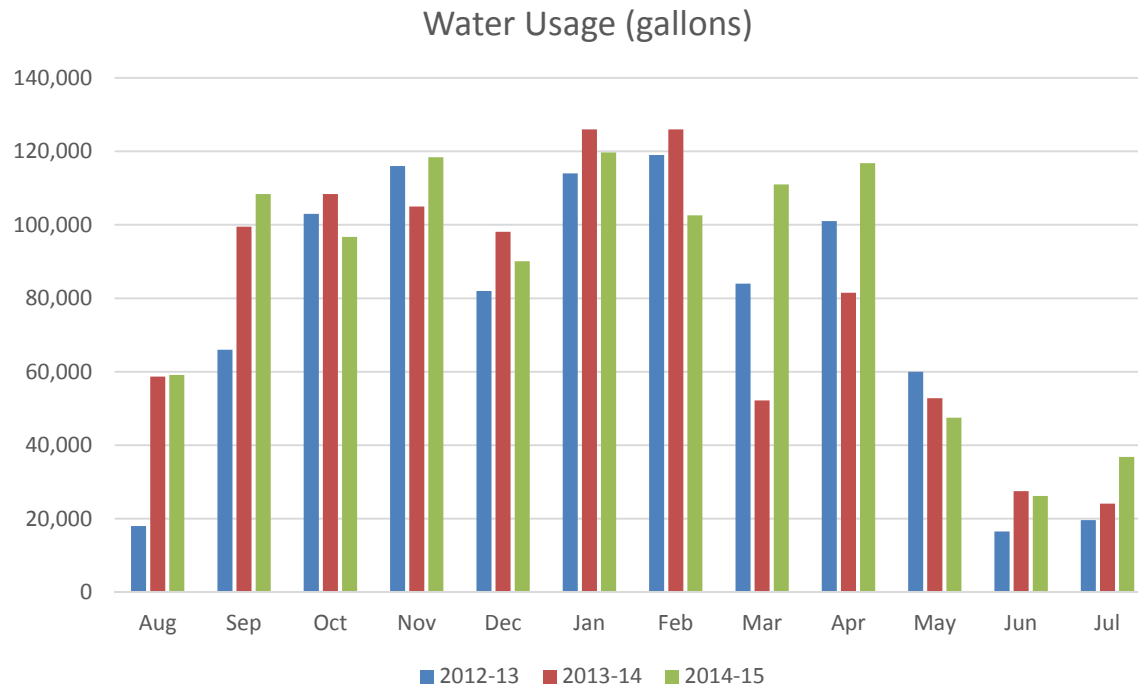

Rippleside Elem. School

Utility Usage Summary

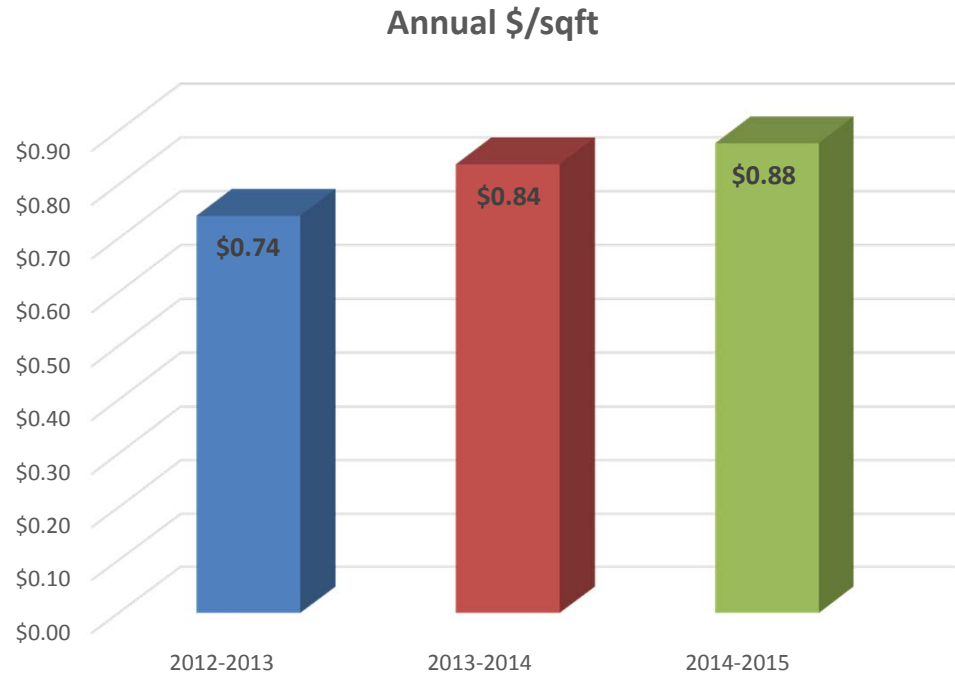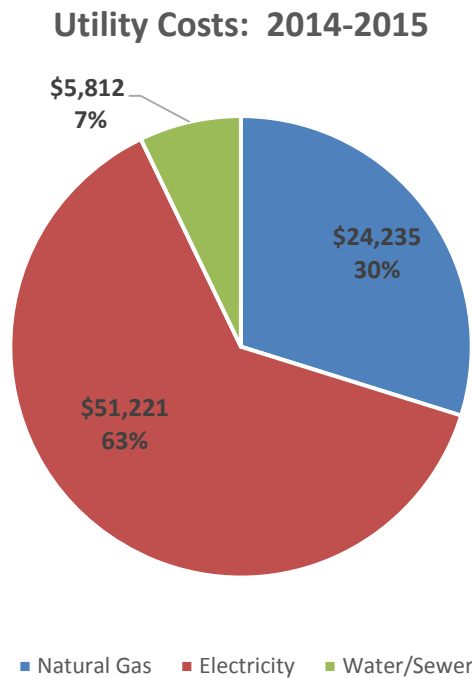

Rippleside Elem. School

Utility Usage Summary

Rippleside Elementary School

92,700 sqft


Year	NATURAL GAS				ELECTRICITY								Water/Sewer			TOTALS	
	Therms	kBtu/sqft	\$	\$/sqft	kWh	kWh \$	kBtu/sqft	kW	kW \$	Total \$	\$/sqft	Gallons	\$	\$/sqft	\$	\$/sqft	
2012-2013	37,161	40.1	\$19,663	\$0.21	437,440	\$29,753	16.1	1,594	\$14,346	\$44,099	\$0.48	670,000	\$5,011	\$0.05	\$68,774	\$0.74	
2013-2014	41,686	45.0	\$28,184	\$0.30	446,800	\$30,594	16.5	1,532	\$13,791	\$44,385	\$0.48	687,790	\$5,069	\$0.05	\$77,639	\$0.84	
2014-2015	34,130	36.8	\$24,235	\$0.26	517,360	\$36,107	19.0	1,654	\$15,114	\$51,221	\$0.55	795,790	\$5,812	\$0.06	\$81,268	\$0.88	
Avg.	37,659	40.6	\$24,027	\$0.26	467,200	\$32,152	17.2	1,593	\$14,417	\$46,569	\$0.50	717,860	\$5,297	\$0.06	\$75,893	\$0.82	




Rippleside Elem. School

Electrical Usage Summary

Electricity Usage (kWh)

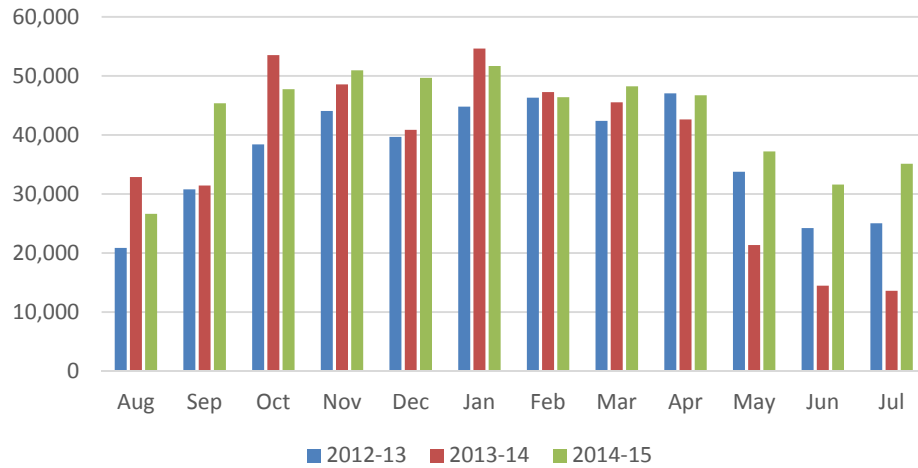


Electricity Demand (kW)

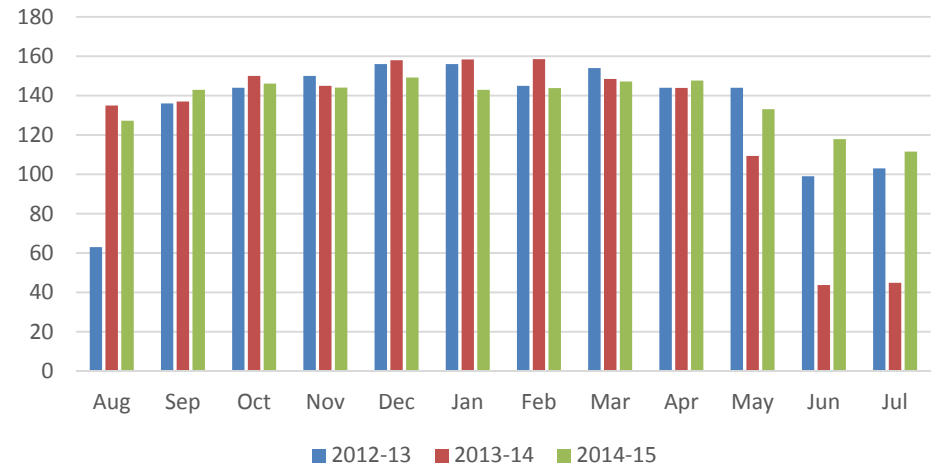


Rippleside Elem. School

Natural Gas Usage Summary

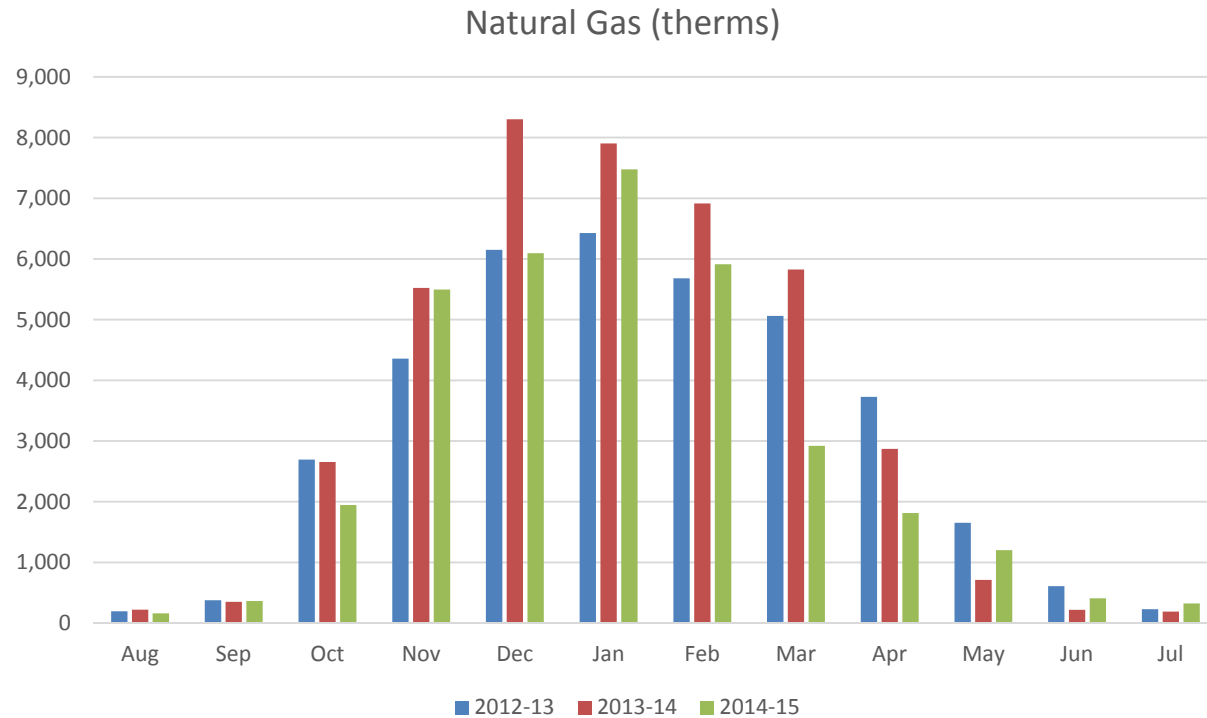

Rippleside Elem. School


Water Usage Summary

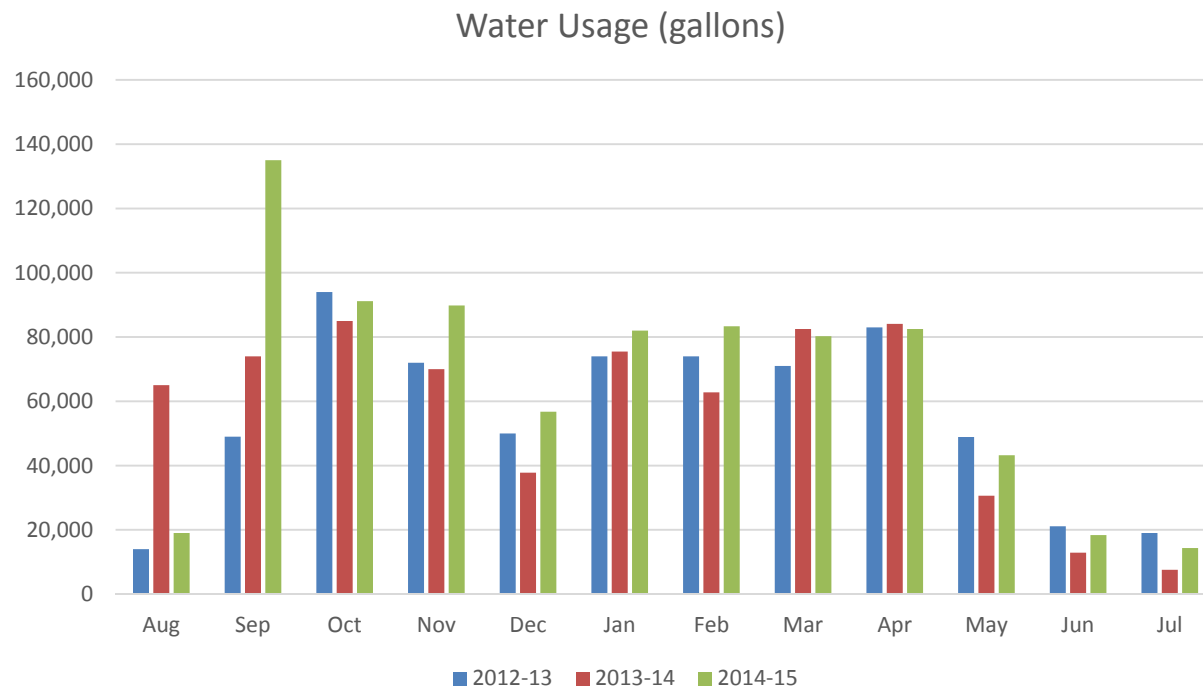

District Utility Comparison

3 year average


TOTAL ANNUAL UTILITY \$

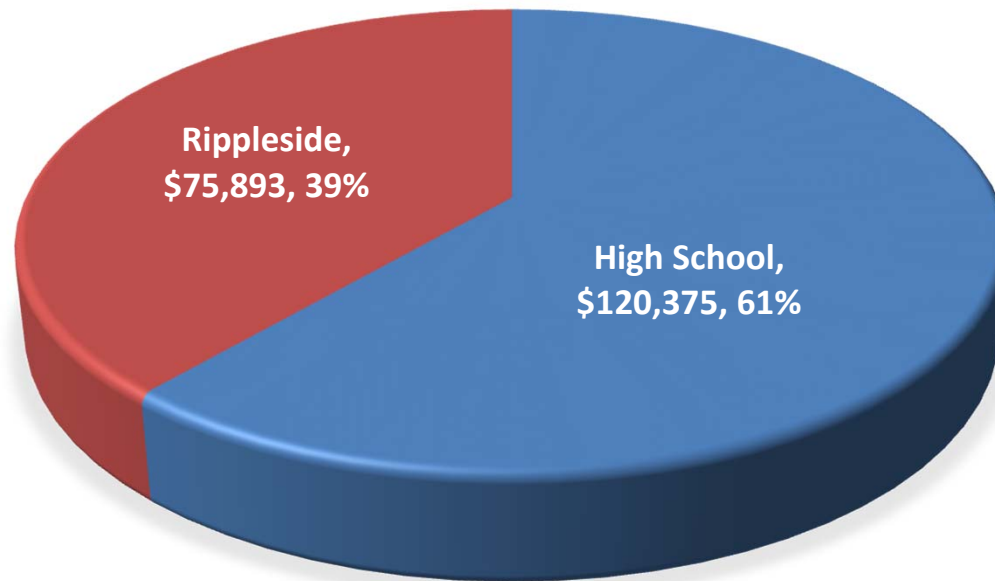

District Utility Comparison

3 year average

Total \$/sqft

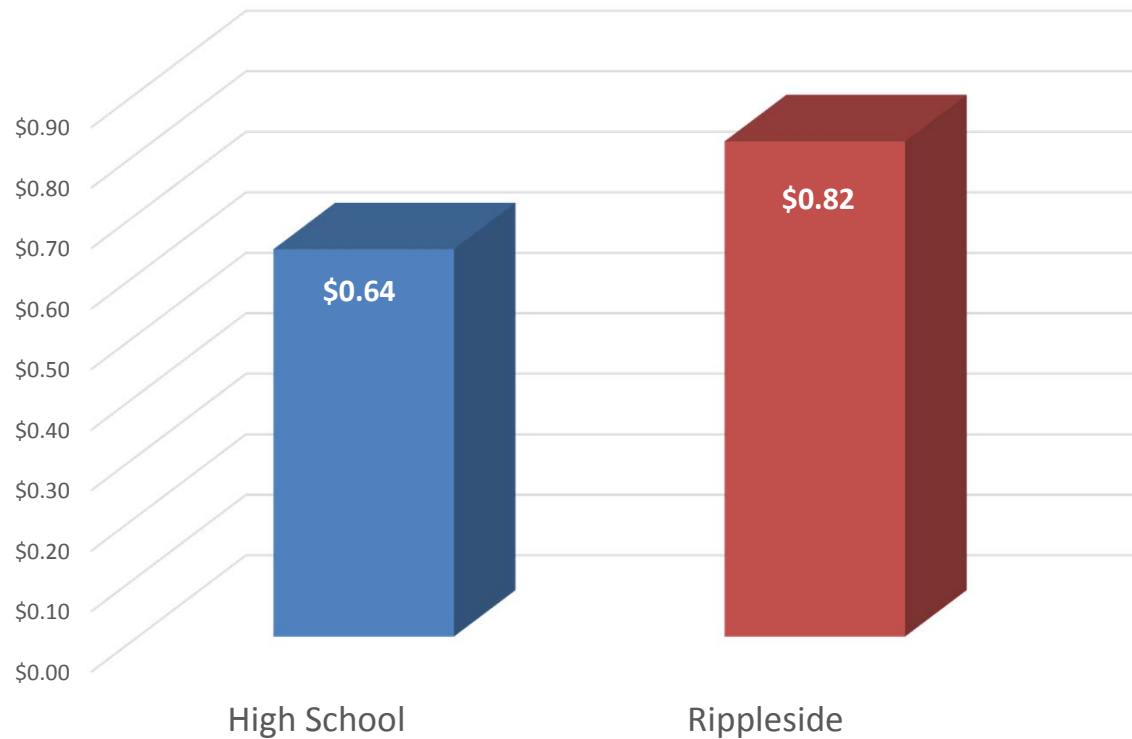

District Utility Comparison

